



Certificate

AKKU 9.8.2017 14:52:17



MK-Battery International
 Unit 6B, Vernon Court Henson Way
 Telford Way Industrial Estate
 Kettering NN16 8PX
 United Kingdom
 Tel.: 0044-1536-484009
 paulr@mkbattery.com


Name

Place of measurement

Instruments:

Meas. date: 7.6.2011 12:00:04

Date: 9.8.2017 14:51:31

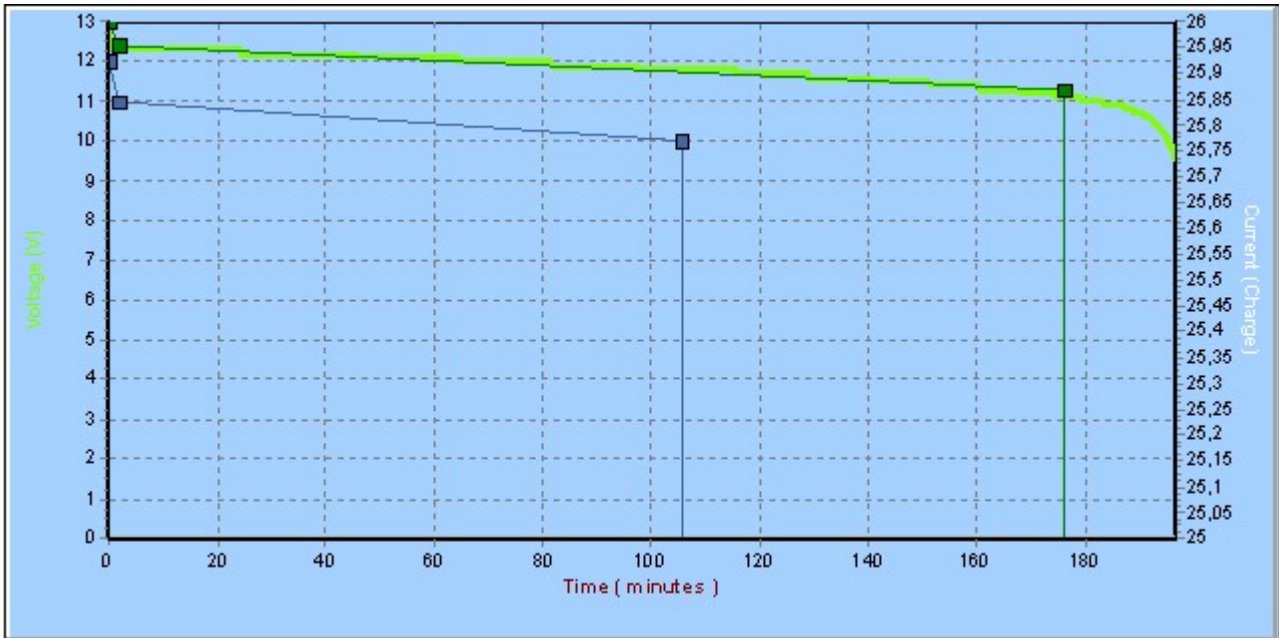

Measurement parameters

Sampling interval 15 seconds
 Discharge current 25 A
 Capacity 100 Ah
 Charging time 0 hours
 Discharge voltage 9,6 V
 Acceptance level 60 %

Results

1 Discharge 3 hours 16 minutes 45 seconds
 81,88 Axh
 Measurement No. 66
 Open circuit voltage 12,9 V
 Measured Capacity 111 %

PASS

Comment, other